

報告號碼 : ETR2329323

頁數(page) : 1 of 5

Report No.



報告日期 : 2023/7/13

Report Date

申請者 : 本土股份有限公司

Applicant

設備名稱 : 無塵室落塵量測

Equipment Name

顧客住址 : 臺中市412大里區四育街45號

Customer Address

量測日期 : 2023/7/11

Measurement Date

量測項目 : 潔淨度量測

Measurement Item

適用規範 : 參考ISO 14644相關規範

Measurement Code

量測結果 : 詳內頁

Measurement Results




報告號碼(Report No.) : ETR2329323

頁數(page) : 3 of 5

### 一、潔淨度量測(十萬級無塵室作業區)

#### 1.位置圖

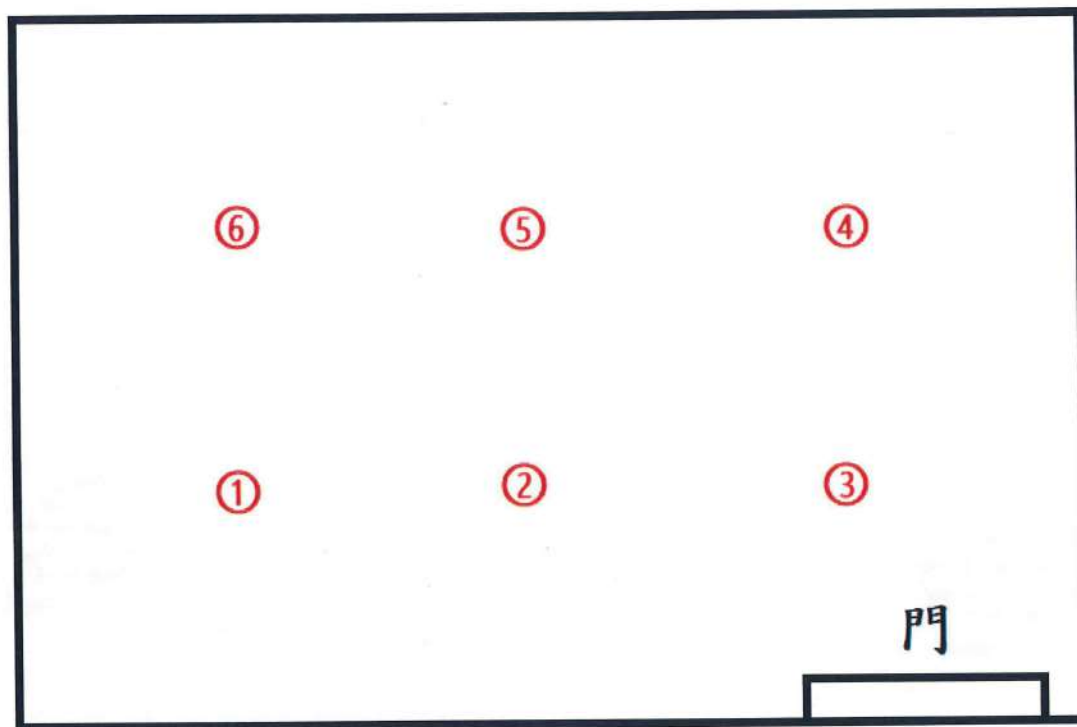

#### 2.落塵數量測



1. (單位 : particles/m <sup>3</sup> )			2. (單位 : particles/m <sup>3</sup> )		
μ	Δ	Σ	μ	Δ	Σ
0.3	43737	83767	0.3	32300	60787
0.5	22910	40030	0.5	16238	28487
1.0	11684	17121	1.0	8825	12249
3.0	1412	5436	3.0	883	3424
5.0	1553	4024	5.0	812	2542
10.0	2471	2471	10.0	1730	1730

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

3. (單位 : particles/m <sup>3</sup> )			4. (單位 : particles/m <sup>3</sup> )		
μ	Δ	Σ	μ	Δ	Σ
0.3	45784	100323	0.3	360519	463948
0.5	29052	54539	0.5	74095	103429
1.0	16979	25487	1.0	20756	29334
3.0	2224	8507	3.0	1942	8578
5.0	2118	6283	5.0	2224	6636
10.0	4165	4165	10.0	4413	4413

5. (單位 : particles/m <sup>3</sup> )			6. (單位 : particles/m <sup>3</sup> )		
μ	Δ	Σ	μ	Δ	Σ
0.3	97675	144130	0.3	58880	95875
0.5	28875	46455	0.5	23122	36994
1.0	11826	17579	1.0	10237	13873
3.0	1659	5754	3.0	1094	3636
5.0	1659	4095	5.0	918	2542
10.0	2436	2436	10.0	1624	1624

### 二、量測位置照片

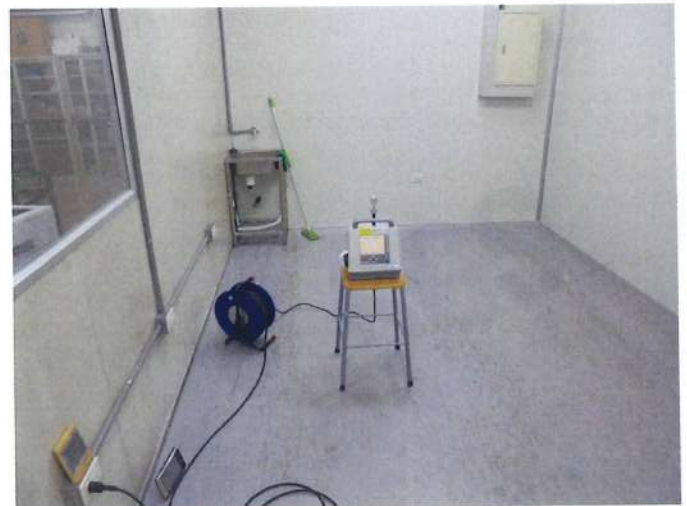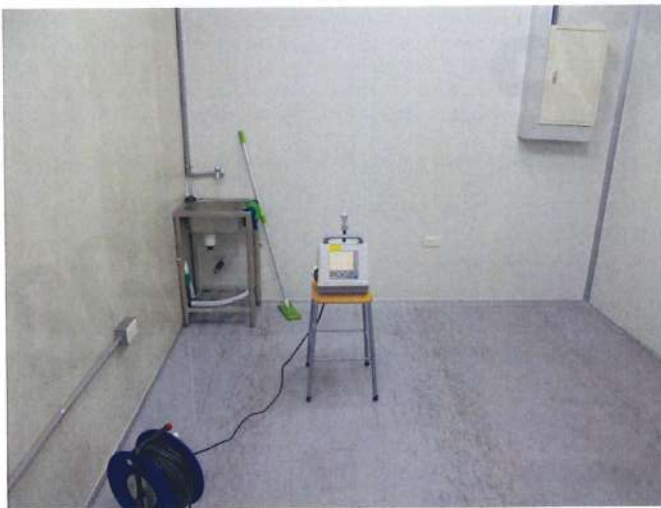



-- THE END --